

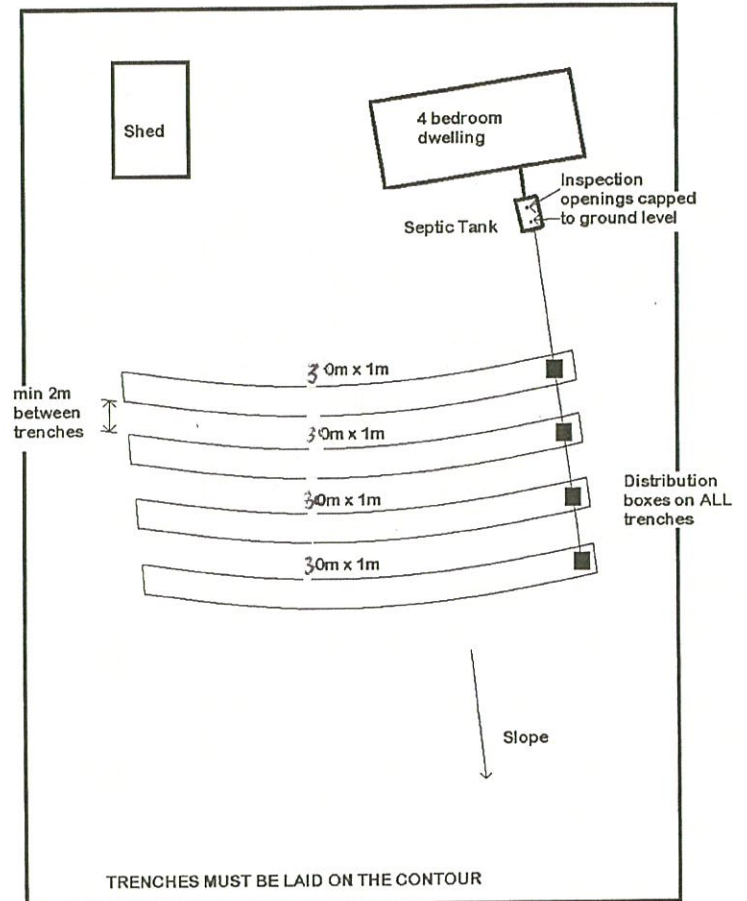


# Absorption Trench Specifications

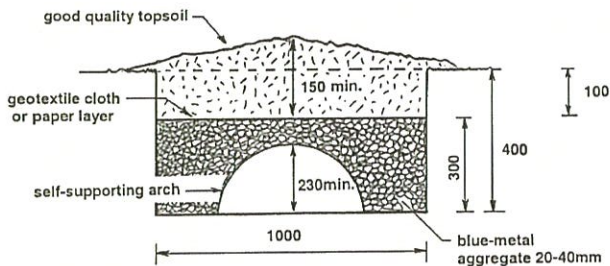

CITY OF  
BALLARAT

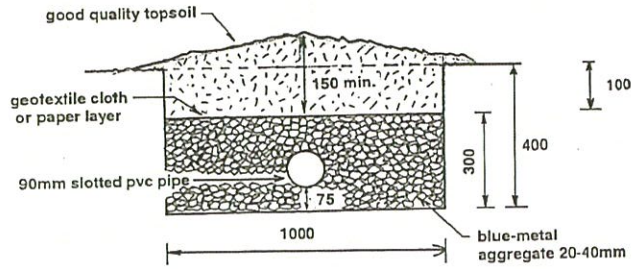

## Materials

- ☞ 3200 litre septic tank
- ☞ 100mm sewer grade pipe to tank
- ☞ Concrete or HDPE DB's
- ☞ Blue Metal aggregate 20-40mm
- ☞ Outlet filter
- ☞ 90mm PVC to DB's
- ☞ Gypsum
- ☞ Multi layer paper or geotextile cloth

Aggregate used within trenches must be of a quality that satisfies the Australian Standard. There are many types of aggregate available from suppliers some of which are not consistent in size or level of contamination from fines. To alleviate issues of aggregate quality 20-40mm blue metal is considered to be the product of choice due to consistent compliance with the Australian Standard. No other aggregate will be permitted without the provision of satisfactory test records in compliance with the Standard